



**State of West Virginia
Request For Quotation
Agricultural**

Procurement Folder : 625566

Document Description : Bowden Hatchery Fish Grading, Counting & Pumping System

Procurement Type : Agency Purchase Order

Date Issued	Solicitation Closes	Solicitation No	Version	Phase
2020-02-18	2020-02-25 13:30:00	ARFQ 0310 DNR2000000017	2	Final

SUBMIT RESPONSES TO:	VENDOR
BID RESPONSE DIVISION OF NATURAL RESOURCES PROPERTY & PROCUREMENT OFFICE 324 4TH AVE SOUTH CHARLESTON WV 25303-1228 US	Vendor Name, Address and Telephone Aquacare Environment Inc 708 Coho Way Bellingham WA 98225 US Tel 360.305.5477

FOR INFORMATION CONTACT THE
 James H Adkins
 (304) 558-3397
 jamie.h.adkins@wv.gov

Signature X *Henning Gatz* **FEIN #** 911422341 **DATE** 25 February 2020

All offers subject to all terms and conditions contained in this solicitation

ADDITIONAL INFORMATION

Addendum No. 01 is issued to publish and distribute the attached information to the Vendor Community.

INVOICE TO		SHIP TO	
DIVISION OF NATURAL RESOURCES WILDLIFE RESOURCES SECTION ELKINS OPERATIONS CENTER PO BOX 67 ELKINS WV26241 US		DIVISION OF NATURAL RESOURCES BOWDEN HATCHERY RT 1, BOX 80 ELKINS WV 26241 US	

Line	Commodity Line Description	Qty	Unit Issue	Unit Price	Total Price
1	Fishing and aquaculture equipment	1.00000	LS	\$108,316.00	\$108,316.00

Commodity Code	Manufacturer	Model #	Specification
21110000	Faivre	PACN-FAST16	See notes below

Extended Description

3.1 Fish grading, counting & pumping system per attached specifications.

SCHEDULE OF EVENTS

Line	Event	Event Date
1	Technical Question Deadline at 9:00 a.m. EST	2020-02-13


Notes to scope of supply - see drawing attached below.

Main items

1. 3.1.1 Fish Grader, 1.0 grams to 120 grams, 120 VAC single phase
2. 3.1.2 Fish Counters, 1 @ 0.2-20 grams, 2 @ 3-150 grams, 120 VAC single phase
3. 3.1.3 Fish Pump, 1.0 - 700 grams, 120 VAC single phase

Included ancillary items

4. Reception tanks after counters
 5. Water pump to supply grader, with hose 120 VAC single phase
 6. Suction hose to fish pump, 6" clear, flexible with fittings
 7. Dewatering discharge hose, 6" clear, flexible with fittings
 8. Control box to operate all components, 120 VAC single phase
 9. Connecting hose pack, 5 meter lengths, clear, flexible with fittings
- Includes freight and delivery to Hatchery. Excludes unloading of shipping container.
 Excludes State and Local taxes, if any.

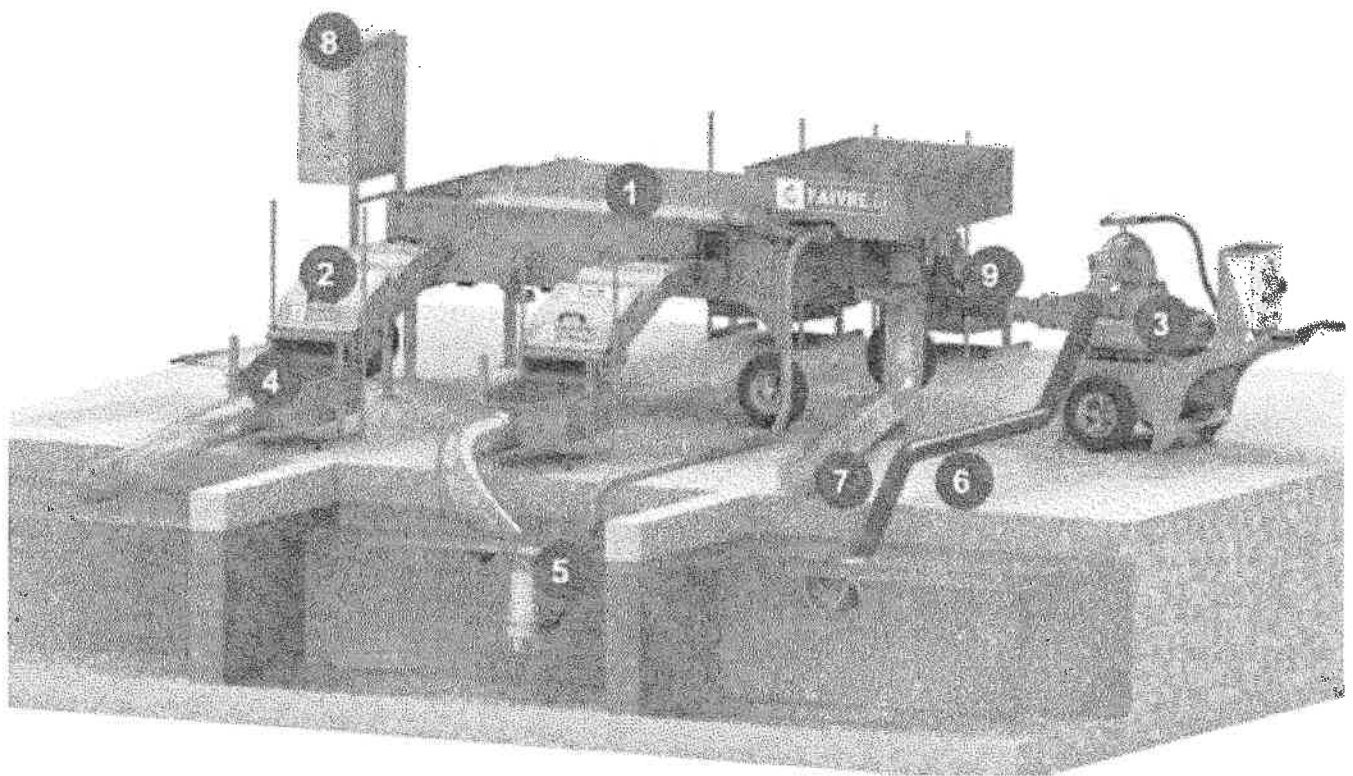

DNR2000000017	Document Phase Final	Document Description Bowden Hatchery Fish Grading, Counting & Pumping System	Page 3 of 3
----------------------	--------------------------------	----------------------------------------------------------------------------------------	------------------------

ADDITIONAL TERMS AND CONDITIONS

See attached document(s) for additional Terms and Conditions

SOLICITATION NUMBER: ARFQ DNR20*17
Bowden Hatchery Fish Grading, Counting & Pumping System
Addendum Number: No. 01

The purpose of this addendum is to modify the solicitation identified as ("Solicitation") to reflect the change(s) identified and described below.

Applicable Addendum Category:

- Modify bid opening date and time
- Modify specifications of product or service being sought
- Attachment of Vendor questions and Agency responses
- Attachment of pre-bid sign-in sheet
- Correction of error
- Other

Description of Modification to Solicitation:

Addendum issued to publish and distribute the attached documentation to the vendor community.

1. To publish Vendor questions and Agency responses.

NO OTHER CHANGES.

Additional Documentation: Documentation related to this Addendum (if any) has been included herewith as Attachment A and is specifically incorporated herein by reference.

Terms and Conditions:

1. All provisions of the Solicitation and other addenda not modified herein shall remain in full force and effect.
2. Vendor should acknowledge receipt of all addenda issued for this Solicitation by completing an Addendum Acknowledgment, a copy of which is included herewith. Failure to acknowledge addenda may result in bid disqualification. The addendum acknowledgement should be submitted with the bid to expedite document processing.

DNR_07042017

Attachment A

ARFQ DNR20*17
Bowden Hatchery Fish Grading, Counting & Pumping System
Vendor submitted Questions and Agency Responses
02/13/2020

1. QUESTION: What species fish?
A. ANSWER: Trout

2. QUESTION: How do you move the fish?
A. ANSWER: Hand loaded on trucks.

3. QUESTION: What size fish pump?
A. ANSWER: *See Item 3.1.3 Fish Pumping System* for specifications.

4. For the fish grader, it is stated:
3.1.1.4 Hourly grading capacity per hour must be one (1) ton minimum.
QUESTION: For which size please?
A. ANSWER: The mandatory size range of 1.0 gram to 100 grams. *See Item 3.1.1.2 & 3.1.1.3*

5. For the Fish Counting System:
3.1.2.6 Must include three (3) flexible translucent pipes a minimum of ten (10) yards in length. Pipes must be smooth inside with cam lock ends compatible with fish grader (*Item 3.1.1*) connections.
QUESTION: Are stainless pipes acceptable as well? They usually help the counter unit to be elevated the right way.
A. ANSWER: No. Pipes must be flexible and translucent.

NO FURTHER CHANGES.